


ANNUAL WATER QUALITY REPORT

WATER TESTING PERFORMED IN 2017

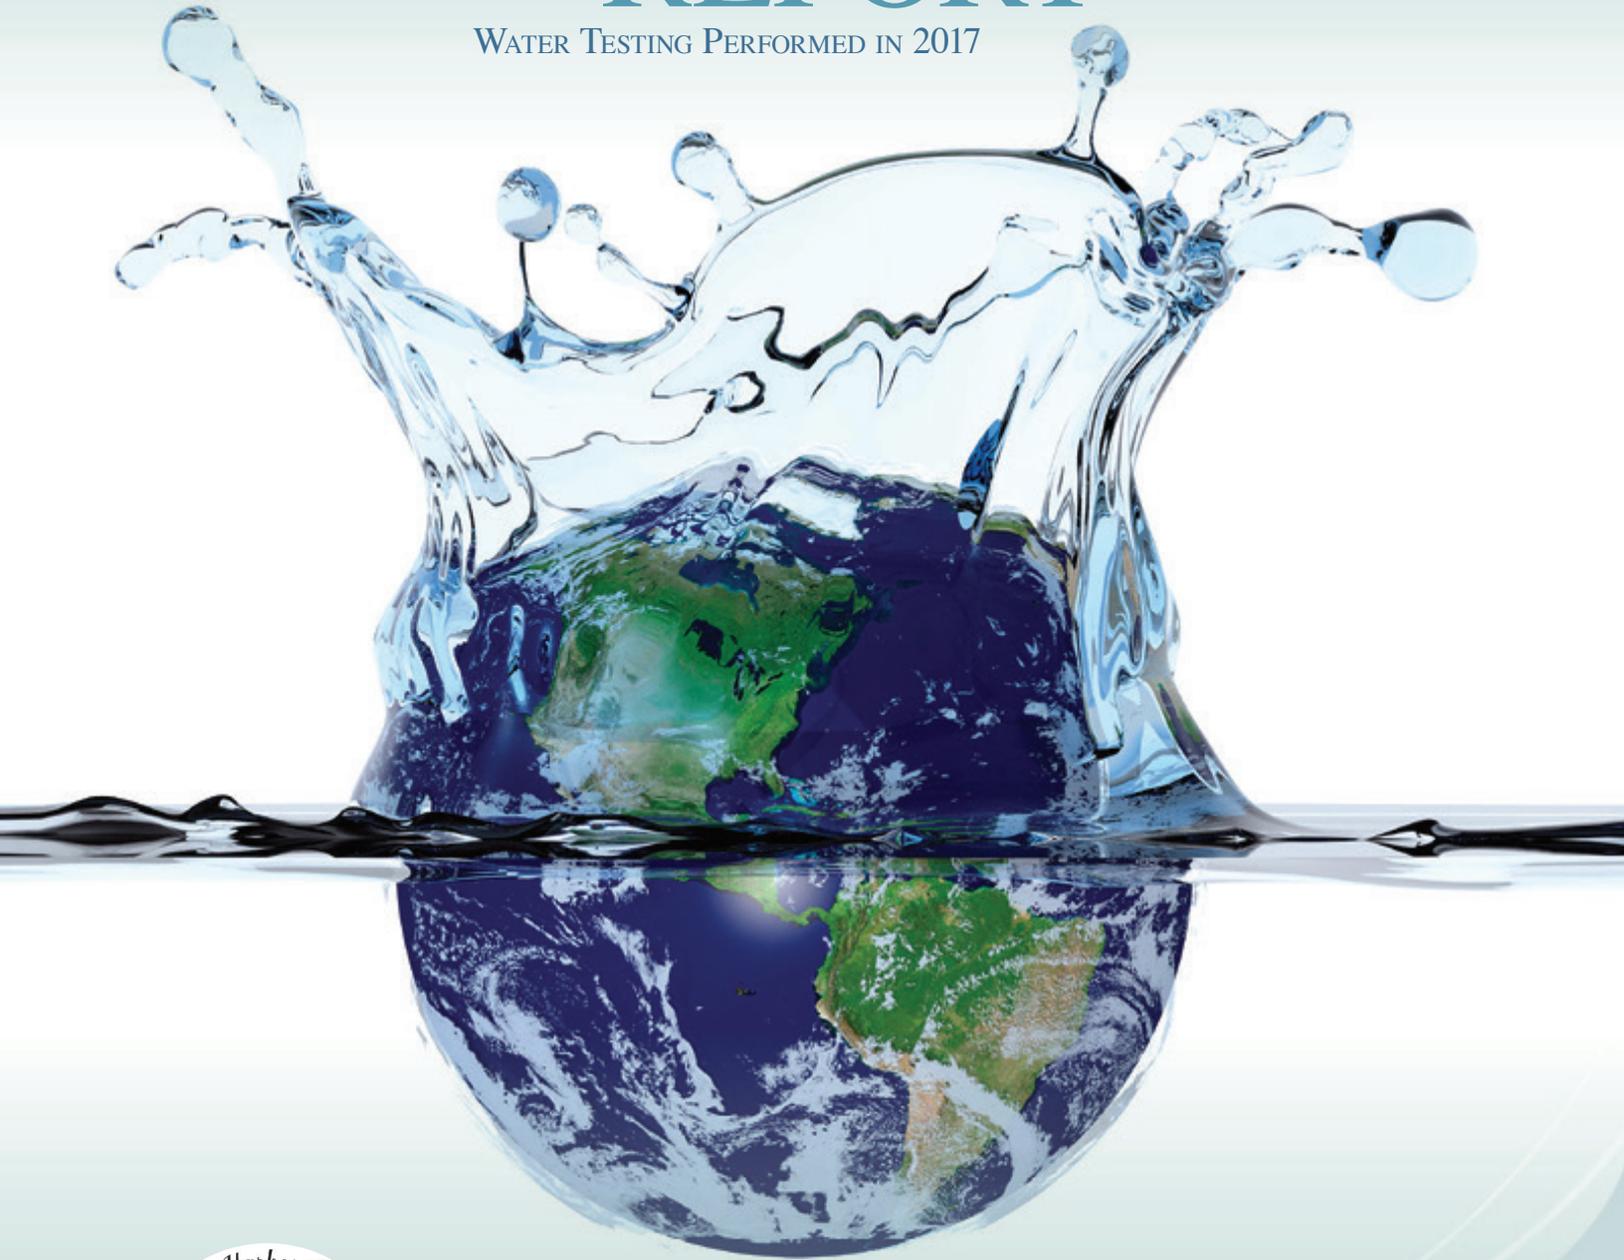

Presented By
City of Aransas Pass

Quality First

Once again we are pleased to present our annual water quality report. As in years past, we are committed to delivering the best-quality drinking water possible. To that end, we remain vigilant in meeting the challenges of new regulations, source water protection, water conservation, and community outreach and education, while continuing to serve the needs of all of our water users. Thank you for allowing us the opportunity to serve you and your family.


We encourage you to share your thoughts with us on the information contained in this report. After all, well-informed customers are our best allies.

Community Participation

You are invited to participate in our public forum and voice your concerns about your drinking water the third Monday of each month, beginning at 6 p.m. at City Hall, 600 W. Cleveland, Aransas Pass, TX.

Important Health Information

You may be more vulnerable than the general population to certain microbial contaminants, such as *Cryptosporidium*, in drinking water. Infants, some elderly, or immunocompromised persons such as those undergoing chemotherapy for cancer; those who have undergone organ transplants; those who are undergoing treatment with steroids; and people with HIV/AIDS or other immune system disorders can be particularly at risk from infections. You should seek advice about drinking water from your physician or health care provider. Additional guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* are available from the Safe Drinking Water Hotline at (800) 426-4791.

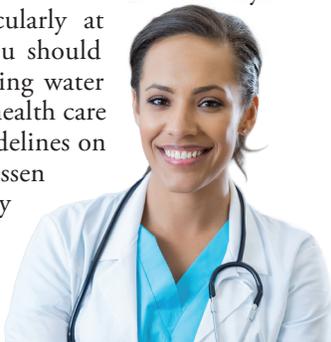

Substances That Could Be in Water

To ensure that tap water is safe to drink, the U.S. EPA prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it can acquire naturally occurring minerals, in some cases, radioactive material; and substances resulting from the presence of animals or from human activity. Substances that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban storm-water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban storm-water runoff, and residential uses;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and which may also come from gas stations, urban storm-water runoff, and septic systems;

Radioactive Contaminants, which can be naturally occurring or may be the result of oil and gas production and mining activities.

Contaminants may be found in drinking water that may cause taste, color, or odor problems. These types of problems are not necessarily causes for health concerns. For more information on taste, odor, or color of drinking water, please contact our business office. For more information about contaminants and potential health effects, call the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

QUESTIONS?

For more information about this report, or for any questions relating to your drinking water, please call Fernando Quintanilla, Public Works Director, or Marilu Mojica, Office Manager, at (361) 758-3111.

Where Does My Water Come From?

All of the drinking water supplied by the San Patricio Municipal Water District (SPMWD) to local communities comes from a surface water system, consisting of Lake Corpus Christi, Choke Canyon Reservoir, and Lake Texana. Water from Choke Canyon and Lake Corpus Christi makes its way down the Nueces River, to intake pumps at Callalen, then by pipeline to the SPMWD facilities. Colorado River water is pumped into Lake Texana via pipeline; water at Lake Texana is then pumped through a 101-mile pipeline to SPMWD. Customers served by systems in Ingleside, Aransas Pass, Portland, Taft, Port Aransas, Rockport, and Fulton receive water treated at the water district's plant near Ingleside.

As water travels over the land's surface and down the river, it dissolves naturally occurring minerals and picks up other contaminants. Untreated water may contain bacteria, viruses, salts, and various organic chemicals and radioactive contaminants, which can be naturally occurring or the result of animals and human activity.

Treatment plants purify water through a process of chemical treatment, settling, filtration, and disinfection. Water treatment chemicals are added to remove impurities, kill harmful bacteria, eliminate taste and odors and help to prevent tooth decay. The same quality drinking water is then delivered to all residential, commercial, and industrial customers.

Water Treatment Process


The treatment process consists of a series of steps. First, raw water is drawn from our water source and sent to an aeration tank, which allows for oxidation of the high iron levels that are present in the water. The water then goes to a mixing tank where polyaluminum chloride and soda ash are added. The addition of these substances cause small particles to adhere to one another (called floc), making them heavy enough to settle into a basin from which sediment is removed. Chlorine is then added for disinfection. At this point, the water is filtered through layers of fine coal and silicate sand. As smaller, suspended particles are removed, turbidity disappears and clear water emerges.

Chlorine is added again as a precaution against any bacteria that may still be present. (We carefully monitor the amount of chlorine, adding the lowest quantity necessary to protect the safety of your water without compromising taste.) Finally, soda ash (used to adjust the final pH and alkalinity), fluoride (used to prevent tooth decay), and a corrosion inhibitor (used to protect distribution system pipes) are added before the water is pumped to sanitized, underground reservoirs, water towers, and into your home or business.



Water Main Flushing

Distribution mains (pipes) convey water to homes, businesses, and hydrants in your neighborhood. The water entering distribution mains is of very high quality; however, water quality can deteriorate in areas of the distribution mains over time. Water main flushing is the process of cleaning the interior of water distribution mains by sending a rapid flow of water through the mains.

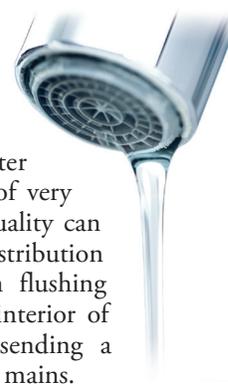

Water treatment is a complex, time-consuming process.

Flushing maintains water quality in several ways. For example, flushing removes sediments such as iron and manganese. Although iron and manganese do not pose health concerns, they can affect the taste, clarity, and color of the water. Additionally, sediments can shield microorganisms from the disinfecting power of chlorine, contributing to the growth of microorganisms within distribution mains. Flushing helps remove stale water and ensures the presence of fresh water with sufficient dissolved oxygen, disinfectant levels, and an acceptable taste and smell.

During flushing operations in your neighborhood, some short-term deterioration of water quality, though uncommon, is possible. You should avoid tap water for household uses at that time. If you do use the tap, allow your cold water to run for a few minutes at full velocity before use, and avoid using hot water to prevent sediment accumulation in your hot water tank.

Please contact us if you have any questions or if you would like more information on our water main flushing schedule.

Source Water Assessment

A Source Water Assessment for your drinking water source is currently being updated by the Texas Commission on Environmental Quality. This information describes the susceptibility and types of constituents that may come into contact with your drinking water source based on human activities and natural conditions. The information contained in the assessment allows us to focus source water protection strategies.

Further details about sources and source-water assessments are available at the Drinking Water Watch website at the following URL: <http://dww2.tceq.texas.gov/DWW/>.

FOG (fats, oils, and grease)

You may not be aware of it, but every time you pour fat, oil, or grease (FOG) down your sink (e.g., bacon grease), you are contributing to a costly problem in the sewer collection system. FOG coats the inner walls of the plumbing in your house as well as the walls of underground piping throughout the community. Over time, these greasy materials build up and form blockages in pipes, which can lead to wastewater backing up into parks, yards, streets, and storm drains. These backups allow FOG to contaminate local waters, including drinking water. Exposure to untreated wastewater is a public health hazard. FOG discharged into septic systems and drain fields can also cause malfunctions, resulting in more frequent tank pump-outs and other expenses.

Communities spend billions of dollars every year to unplug or replace grease-blocked pipes, repair pump stations, and clean up costly and illegal wastewater spills. Here are some tips that you and your family can follow to help maintain a well-run system now and in the future:

NEVER:

- Pour fats, oil, or grease down the house or storm drains.
- Dispose of food scraps by flushing them.
- Use the toilet as a waste basket.

ALWAYS:

- Scrape and collect fat, oil, and grease into a waste container such as an empty coffee can, and dispose of it with your garbage.
- Place food scraps in waste containers or garbage bags for disposal with solid wastes.
- Place a wastebasket in each bathroom for solid wastes such as disposable diapers, creams and lotions, and personal hygiene products, including nonbiodegradable wipes.

Lead in Home Plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. This water supply is responsible for providing high-quality drinking water, but cannot control the variety of materials used in plumbing components.

When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead

in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/safewater/lead.



BY THE NUMBERS

The number of gallons of water produced daily by public water systems in the U.S. **34 BILLION**

1 MILLION The number of miles of drinking water distribution mains in the U.S.

The amount of money spent annually on maintaining the public water infrastructure in the U.S. **135 BILLION**

300 MILLION The number of Americans who receive water from a public water system.

The age in years of the world's oldest water found in a mine at a depth of nearly two miles. **2 BILLION**

151 THOUSAND The number of active public water systems in the U.S.

The number of highly trained and licensed water professionals serving in the U.S. **199 THOUSAND**

Water Loss Audit

In the water loss audit submitted to the Texas Water Development Board during the year covered by this report, our system lost on average 81.9 gallons of water per connection per day. If you have any questions about the water loss audit, please call Public Works at (361) 758-3111, ext. 3131.

Test Results

Our water is monitored for many different kinds of substances on a very strict sampling schedule. The information in the data tables shows only those substances that were detected between January 1 and December 31, 2017. Remember that detecting a substance does not necessarily mean the water is unsafe to drink; our goal is to keep all detects below their respective maximum allowed levels. The State recommends monitoring for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data are included, along with the year in which the sample was taken.

We participated in the 3rd stage of the EPA's Unregulated Contaminant Monitoring Rule (UCMR3) program by performing additional tests on our drinking water. UCMR3 benefits the environment and public health by providing the EPA with data on the occurrence of contaminants suspected to be in drinking water, in order to determine if EPA needs to introduce new regulatory standards to improve drinking water quality. Contact us for more information on this program.

During the month of February 2017, we did not timely report the results of the monitoring for total coliform to our regulatory agency. We have taken steps to make sure we report all results timely and to prevent this from happening again in the future. We do not believe that missing this monitoring reporting requirement had any impact on public health.

REGULATED SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	MCL [MRDL]	MCLG [MRDLG]	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Barium (ppm)	2017	2	2	0.0982	NA	No	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits
Chlorine (ppm)	2017	[4]	[4]	4.2	3.7–4.8	No	Water additive used to control microbes
Fluoride (ppm)	2017	4	4	0.570	0.53–0.60	No	Erosion of natural deposits; Water additive, which promotes strong teeth
Haloacetic Acids [HAA] (ppb)	2017	60	NA	26.1	18–37	No	By-product of drinking water disinfection
Nitrate (ppm)	2017	10	10	2.71	2.4–3.2	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
TTHMs [Total Trihalomethanes] (ppb)	2017	80	NA	26.3	18–40	No	By-product of drinking water disinfection
Total Organic Carbon (ppm)	2017	TT	NA	6.61	5.9–7.28	No	Naturally present in the environment

Tap Water Samples Collected for Copper and Lead Analyses from Sample Sites throughout the Community

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AL	MCLG	AMOUNT DETECTED (90TH%TILE)	SITES ABOVE AL/ TOTAL SITES	VIOLATION	TYPICAL SOURCE
Copper (ppm)	2016	1.3	1.3	0.0369	0/5	No	Corrosion of household plumbing systems; Erosion of natural deposits
Lead (ppb)	2016	15	0	1.9	0/5	No	Corrosion of household plumbing systems; Erosion of natural deposits

SECONDARY SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	SCL	MCLG	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Manganese (ppb)	2017	50	NA	1.4	NA	No	Leaching from natural deposits

UNREGULATED SUBSTANCES ¹

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AMOUNT DETECTED	RANGE LOW-HIGH	TYPICAL SOURCE
Bromodichloromethane (ppb)	2017	9.1	6.6–12.0	By-product of drinking water disinfection
Bromoform (ppb)	2017	3.8	1.3–8.4	By-product of drinking water disinfection
Dibromochloromethane (ppb)	2017	8.3	4.5–15	By-product of drinking water disinfection
Sulfate (ppm)	2017	58	34–71	Naturally occurring; Oilfield by-product

¹ Unregulated contaminants are those for which EPA has not established drinking water standards. The purpose of unregulated contaminant monitoring is to assist EPA in determining the occurrence of unregulated contaminants in drinking water and whether future regulation is warranted.

Definitions

AL (Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal):

The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).

SCL (Secondary Constituent Level): SCLs are established to regulate the aesthetics of drinking water like appearance, taste and odor.

TT (Treatment Technique): A required process intended to reduce the level of a contaminant in drinking water.